ISSN: 2582-4686 SJIF 2021-3.261,SJIF 2022-2.889,
2024-6.875 ResearchBib IF: 9.948 / 2024

THE MULTIDISCIPLINARY JOURNAL OF SCIENCE AND TECHNOLOGY

VOLUME-5, ISSUE-6

SIMULATION OF THE CONVERSION PROCESSES OF ASYMMETRIC THREE-PHASE REACTIVE POWER INTO SECONDARY VOLTAGE

Kurbaniyazov T.U
Bazarbayev A.B
Nukus State Technical University. Address: 230100, Uzbekistan, Republic of Karakalpakstan, City: Nukus, A. Dosnazarov street №181.

Key words: *Asymmetric current, three-phase, reactive power system, converter, sensitive element, primary current, secondary voltage, graph model.*

INTRODUCTION

The analysis of asymmetric three-phase current transducer sensors (ATPCTS) requires the application of advanced modeling tools and modern engineering approaches to investigate the operational characteristics of electromagnetic transducers that transform three-phase input currents into corresponding secondary voltage signals. This study presents a comprehensive examination of mathematical models and formulations tailored to evaluate the dynamics, physical parameters, and components involved in electric and magnetic energy conversion systems. Such systems are fundamental to the functionality of three-phase electromagnetic current converters used for monitoring and regulating asymmetric currents in reactive power networks, providing essential understanding for their integration into sophisticated power management infrastructures.

MAIN PART

The transformation of reactive power in power supply systems into a secondary voltage signal derived from asymmetric three-phase input currents, along with the modeling and investigation of the corresponding devices and sensors, is performed according to a set of defined algorithms.

The modeling process, which involves the conversion of energy and signals within various physico-technical systems—such as energy sources and transducers responsible for converting reactive current components into secondary electrical signals—is conducted systematically. This includes the development and analysis of the structure and functionality of control and monitoring sensors, following a specific sequence of procedures.

1. A model of the process of transforming two primary electric currents I_{in} into a magnetomotive force F_{μ} is constructed (Fig. 1):

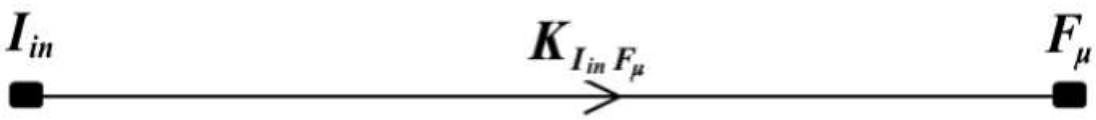


Figure 1. *The model of the process of converting the primary electric current into a magnetomotive force.*

where $K_{IinF\mu}$ is the coefficient of interchain coupling of the conversion of an electrical quantity to a magnetic quantity.

- An analytical representation (1) of the relationship between the magnetomotive force $F_{\mu}F_{\mu}$ of the magnetic conversion part and the current of the initial electric circuit I_kI_k is constructed:

$$F_{\mu} = K_{IkF\mu}I_kF_{\mu} = K_{IinF\mu}\,I_{in}F_{\mu} = K_{IinF\mu}\,I_{in}, \quad (1)$$

ISSN: 2582-4686 SJIF 2021-3.261,SJIF 2022-2.889,
2024-6.875 ResearchBib IF: 9.948 / 2024

THE MULTIDISCIPLINARY JOURNAL OF SCIENCE AND TECHNOLOGY

VOLUME-5, ISSUE-6

where $К_{IinFμ}К_{IinFμ}$ is the cross-linking coefficient of the process of converting the magnetomotive force $F_μ$ into the starting current of the electrical circuit.

2. A model of the process of changing the magnetomotive force $F_μF_μ$ and the magnetic flux $Φ_μΦ_μ$ is constructed (Fig. 2):




Figure 2. *The magnetomotive force is a model of the process of changing the magnetic flux.*

where $ПП$ is the cross-linking coefficient of the transformation of the magnetomotive force into a magnetic flux.

- An analytical representation (2) of the dependence of the initial electrical circuit between the magnetic flux $Φ_μ$ and the magnetomotive force $F_μF_μ$ is constructed:

$$Φ_μ = ПF_μΦ_μ = ПF_μ, \quad (2)$$

where $ПП$ is the coefficient of interconnection between the magnetomotive force $F_μF_μ$ and the process of converting $Φ_μΦ_μ$ into an electromagnetic flow.

3. A model of the relationship between the magnetic flux $Φ_μΦ_μ$ and the secondary output voltage $U_{sh}U_{sh}$ - the secondary signal is constructed (Fig. 3):




Figure 3. *Model of the process of converting the magnetic flux into a secondary output voltage - a secondary signal.*


An analytical expression (3) is constructed for the process of converting the magnetic flux of the magnetic converter $Φ_μ$ into a secondary output voltage U_{in}:

$$U_{out} = К_{ΦμUч}\,Φ_μU_{out} = К_{ΦμUout}\,Φ_μU_{out} = К_{ΦμUout}\,Φ_μ$$

$$U_{sh} = К_{ΦμUsh}Φ_μ, \quad (3)$$

where $К_{ΦμUout}К_{ΦμUout}$ is the cross-linking coefficient of the magnetic flux transformation into a secondary output voltage.

a) A graph model of the output voltage generation of a single-phase single-sensitive element sensor with accumulated parameters of an electrical network connected to a reactive power source of the power supply system has been formed (Fig. 4).



ISSN: 2582-4686 SJIF 2021-3.261,SJIF 2022-2.889,
2024-6.875 ResearchBib IF: 9.948 / 2024

THE MULTIDISCIPLINARY JOURNAL OF SCIENCE AND TECHNOLOGY

VOLUME-5, ISSUE-6

Figure 4. *A graph model for generating the output voltage of electromagnetic current-to-voltage converters with an expanded functional capability with a single-phase single-sensitive element with accumulated parameters.*

The analytical expression formulated based on the graph model of the output voltage generation of a single-phase single-sensitive element sensor with aggregate parameters of the reactive power source of the power supply system is in the form of (5) [13.14,15]:

$$U_{out} = K_{IinF\mu}\Pi_{\mu} K_{\Phi\mu} I_{in}, U_{out} = K_{IinF\mu}\Pi_{\mu} K_{\Phi\mu} I_{in},$$
$$U_{sh} = K_{IkF\mu}\Pi_{\mu} K_{\Phi\mu} I_k U_{ч} = K_{IкF\mu}\Pi_{\mu} K_{\Phi\mu} I_{к},$$
$$U_{out} = K_{IinF\mu}\Pi_{\mu} K_{\Phi\mu} I_{in}, \quad (4)$$

where: $K_{IinF\mu}K_{IinF\mu}$ - is the cross-linking coefficient of the process of converting the magnetomotive force into the initial current of the electrical circuit.

$\Pi_{\mu}\Pi_{\mu}$ - the cross-linking coefficient of the transformation of the magnetomotive force into a magnetic flux.

$K_{\Phi\mu}K_{\Phi\mu}$ - the cross-linking coefficient of the change in the magnetic flux to the secondary output voltage.

I_{in} I_{in} - the initial current of the electric circuit.

A graph model has been formed that generates the output voltage of a two-phase single-sensitive element sensor with distributed parameters of an electrical network connected to a reactive power source in the power supply system (Fig. 4).

b) Figure 5 shows a graph model of the output voltage of a three-phase three-sensitive element sensor with distributed parameters of an electrical network connected to a reactive power source in the power supply system:

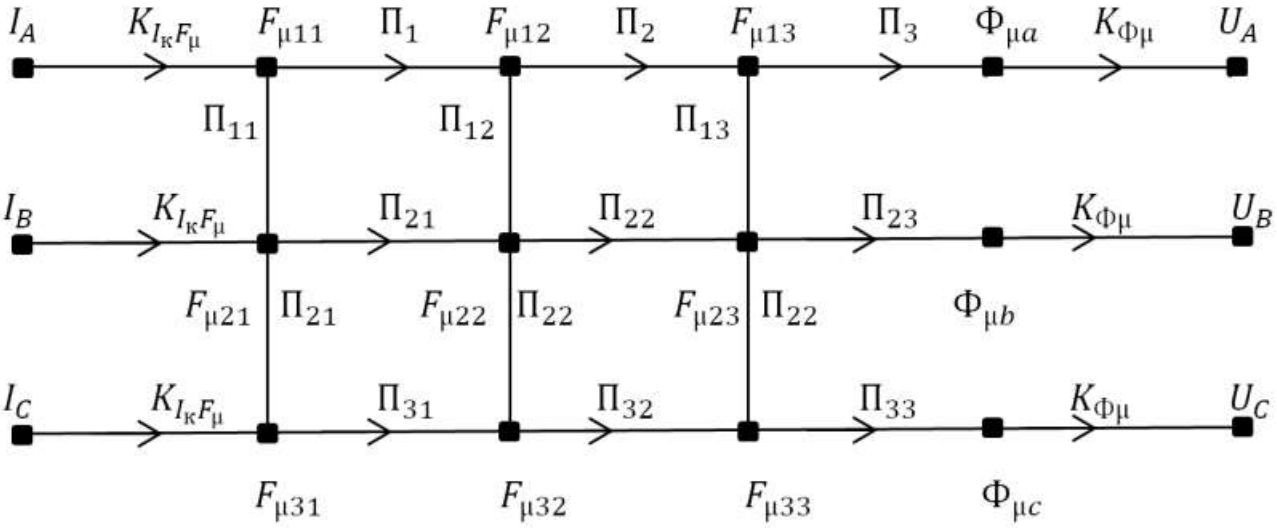


Figure 5. *Graph model for generating the output voltage of electromagnetic current-to-voltage converters with extended functionality with three-phase three-sensitive elements with distributed parameters.*

ISSN: 2582-4686 SJIF 2021-3.261,SJIF 2022-2.889,
2024-6.875 ResearchBib IF: 9.948 / 2024

The analytical expression obtained based on the graph model of the output voltage formation of a three-phase three-sensitive element sensor with a distributed parameter has the form (5), (6) and (7):

$$U_A = W_{IU}(I_A, U_A)I_A + W_{IU}(I_B, U_A)I_B + W_{IU}(I_C, U_A)I_C$$

$$U_A = W_{IU}(I_A, U_A)I_A + W_{IU}(I_B, U_A)I_B + W_{IU}(I_C, U_A)I_C, \quad (5)$$

$$U_B = W_{IU}(I_A, U_B)I_A + W_{IU}(I_B, U_B)I_B + W_{IU}(I_C, U_B)I_C$$

$$U_B = W_{IU}(I_A, U_B)I_A + W_{IU}(I_B, U_B)I_B + W_{IU}(I_C, U_B)I_C, \quad (6)$$

$$U_C = W_{IU}(I_A, U_C)I_A + W_{IU}(I_B, U_C)I_B + W_{IU}(I_C, U_C)I_C$$

$$U_C = W_{IU}(I_A, U_C)I_A + W_{IU}(I_B, U_C)I_B + W_{IU}(I_C, U_C)I_C \quad (7)$$

where: $W_{IU}(I_A,U_A)$, $W_{IU}(I_B,U_A)$, $W_{IU}(I_C,U_A)$, $W_{IU}(I_A,U_B)$, $W_{IU}(I_B,U_B)$, $W_{IU}(I_C,U_B)$, $W_{IU}(I_A,U_c)$, $W_{IU}(I_B,U_c)$, $W_{IU}(I_C,U_c)$- The functions of transferring initial currents I_A, I_B, I_C into secondary U_A, U_B, U_C.

Investigation of analytical expressions obtained based on graph models and algorithms presented in Figures 4 and 5 [3, 4, 5, 6, 11, 12].

CONCLUSION

Three-phase electromagnetic current-to-voltage converters enable precise and rapid control of power sources by utilizing reference signals, ensuring the reliable operation of measurement instruments used to detect reactive power asymmetry within the power supply network.

The necessity of considering the interactions induced by three-phase currents in the primary phases of electrical networks—through the use of electromagnetic converters—along with the analysis of magnetic flux variations and the generation of voltage signals in the secondary winding, has led to the development of a new class of three-phase current converters.

Therefore, an algorithm and models have been developed for investigating the process and components of converting the electrical energy generated by reactive power sources into a secondary signal of multiphase initial currents U_{in} - output voltage. The created graphical models provide the possibility of investigating the signal transformation process and structure of three-phase current sensors based on openness, high formalization, accuracy, and reliable sequence.

References

1. Правила устройства электроустановок (ПУЭ) (Официальное издание) /Гуломов Б.Х., Салиев А.Г., Ташпулатов Б.Т., Тешабаев Б.М., Кадыров Т.М., Каримов Х.Г., Камалов Т.С., Халиков С.С., Саидходжаев А.Г., Гайибов Т.Ш., Сиддиков И.Х., Усманов Э.Г., Бурхонходжаев О.М., Таслимов А.Д,,Рисмухаммедов Д.А., Сайфуллаева Л.И. Ташкент: ГИ Узгосэнергонадзор. - 2007. – 450 с.

2. Siddikov I. K. et al. Statistical descriptions of multiphase current sensers of reactive power control systems in renewable power supply power systems //AIP Conference Proceedings. – AIP Publishing, 2023. – Т. 2789. – №. 1.

3. Abubakirov A., Kurbaniyazov T., Bekimbetov M. Analysis of three-phase asymmetrical currents in the secondary voltage of signal change sensors in the power supply system using graph models //E3S Web of Conferences. – EDP Sciences, 2024. – Т. 525. – С. 03013.

4. Kurbaniyazov, Timur Urunbayevich (2025) “Static Characteristics Of An Electromagnetic Three-Phase Reactive Power Sensor For Converting Asymmetric Currents,” *Chemical Technology, Control and Management*: Vol. 2025: Iss. 2, Article 6. DOI: **https://doi.org/10.59048/2181-1105.1662**

ISSN: 2582-4686 SJIF 2021-3.261,SJIF 2022-2.889,
2024-6.875 ResearchBib IF: 9.948 / 2024

5. Kurbaniyazov T., Bazarbayev A. Analysis of measurement of harmonic power of non-sinusoidal currents in modern electrical networks //Международный научный журнал «Инженер». – 2025. – Т. 3. – №. 2. – С. 44-47.

6. Сиддиков И.Х. Исследование основных характеристик и принципов построения электромеханических преобразователей электроавтоматики на основе графовой модели // Вестник ТашГТУ. – Ташкент, 2001. - № 1. – С. 11-17.

7. Abubakirov, A. B., Najmatdinov, Q. M., Kurbaniyazov, T. U., & Kuatova, S. B. (2021). Sensor characteristics monitoring and control of single and three-phase currents in electric networks.Academicia: An International Multidisciplinary Research Journal,11(3), 2282-2287.

8. Abubakirov, A. B., Tanatarov, R. J., Kurbaniyazov, T. U., & Kuatova, S. B. (2021). Application of automatic control and electricity measurement system in traction power supply system. Academicia: An International Multidisciplinary Research Journal, 11(3), 180-186.

9. Kh, Siddikov I. "Permissible Voltage Asymmetry for Asynchronous Motor Control in Non-Nominal Operating Situations." American Journal of Social and Humanitarian Research 3.9 (2022): 55-64.

10. INTER, F. L. I. (2017). An International Multidisciplinary Research Journal. An International Multidisciplinary Research Journal, 41(43).

11. Kurbaniyazov, T. U. (2022). Distributed Active and Reactive Power Control With Smart Microgrid Demonstration. Middle European Scientific Bulletin, 30, 1-9.

12. Bazarbayevich A. A., Urunbayevich K. T., Pirnazarovich N. M. Reactive power and voltage parameters control in network system //Innovative Achievements In Science 2022. – 2022. – Т. 2. – №. 13. – С. 16-20.

13. Азимов Р.К., Сиддиков И.Х., Анарбоев М.А., Курбонова М.Ж., Назаров Ф Д., Сиддиқов О.И., Маматқулов А.Н. Преобразователь тока в напряжение..// Патент Руз IAP 04907 Б.И. №6, 2014 г.

14. Kurbaniyazov T. U., Bazarbaev A. B. Modeling the processes of conversion of asymmetrical three-phase currents into output voltage //TASHKENT STATE TRANSPORT UNIVERSITY ENGINEER. – 2024. – Т. 2. – №. 4. – С. 2024.

15. Kurbaniyazov T.U. Elektr ta’minoti tizimining reaktiv quvvatlarini uch fazali nosimmetrik toklarini IoT ilovasi asosidagi o‘lchov va nazoratining elektromagnitli datchiklari: Diss., PhD – Tashkent 2024. -117 c.